


# GW

## MULTIPLE JET CONTROL (MJC)

80mm (3") / heat activated (12mm bulb)

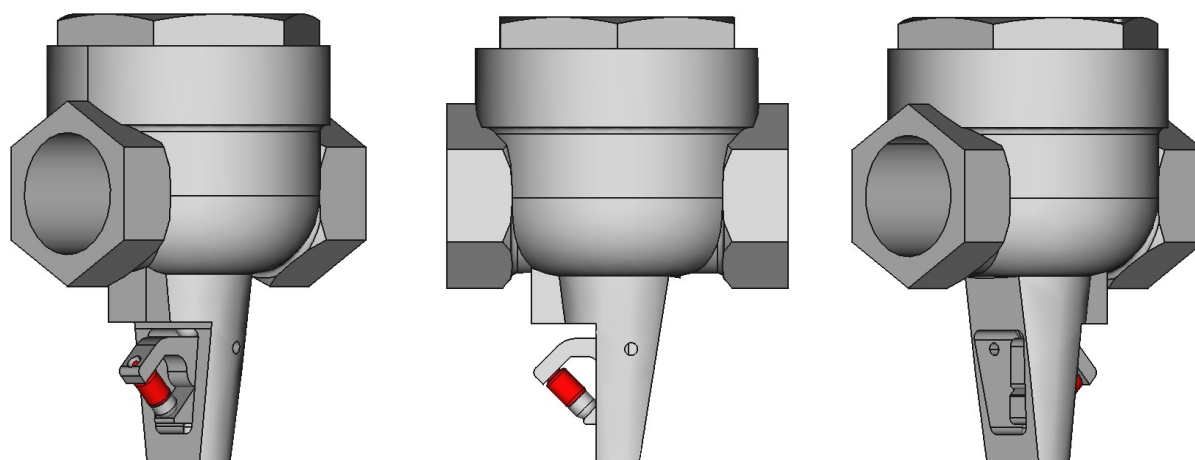

### General Description

The GW MJC is a one directional in-line valve with double outlet, held closed by a frangible glass bulb heat sensitive element. MJC valves are particularly used in applications where a small number of nozzles (open sprinklers) need to activate simultaneously and form a concentrated spray pattern over a defined area.

The MJC housing is cast gunmetal. However, the internal mechanism is **not** suitable for use with sea water or corrosive liquids.

### Technical Specification

|  |                                 |
|--|---------------------------------|
| <b>Seal</b>                                | Nickel Silver (metallic seal)   |
| <b>Weight</b>                              | 7 kg (without Guard*)           |
| <b>Body (material)</b>                     | Gunmetal                        |
| <b>Max. pipe work velocity</b>             | 4,6 m/s                         |
| <b>Max. working pressure</b>               | 12 bar                          |
| <b>Max. test pressure</b>                  | 18 bar (for max. 1 hour)        |
| <b>Heat sensitive element (bulb)</b>       | Glass (quartzoid) – Ø12mm       |
| <b>Release temperature</b>                 | 57 – 68 – 79 – 93 – 141 -182 °C |
| <b>RTI (response time index)</b>           | Standard B: RTI = 280           |
| <b>Threaded connection ( inlet: DN 80)</b> | 3" BSPT (x1)                    |
| <b>Threaded connection (outlet: DN 50)</b> | 2" BSPT (x2)                    |
| <b>*Guard (optional)</b>                   | SS304 – Ø2mm wire / 0,112 kg    |

**GW SPRINKLER A/S**  
Kastanievej 15, DK 5620-Glamsbjerg, Denmark  
TEL: +45 64722055 FAX: +45 64722255  
Email: [sales.dep@gwspinkler.com](mailto:sales.dep@gwspinkler.com)  
Data sheet also available at [www.gwsprinkler.com](http://www.gwsprinkler.com)

Data Sheet: GW Multiple Jet Control  
80mm, heat activated  
(12mm bulb)

Page: 1 of 4

Issue / Date: 01<sup>st</sup> November 2022

**DATA SHEET No: GW MJ050 1002 A**

# GW


## MULTIPLE JET CONTROL (MJC)

80mm (3") / heat activated (12mm bulb)




GW SPRINKLER A/S

### Dimensions (mm)

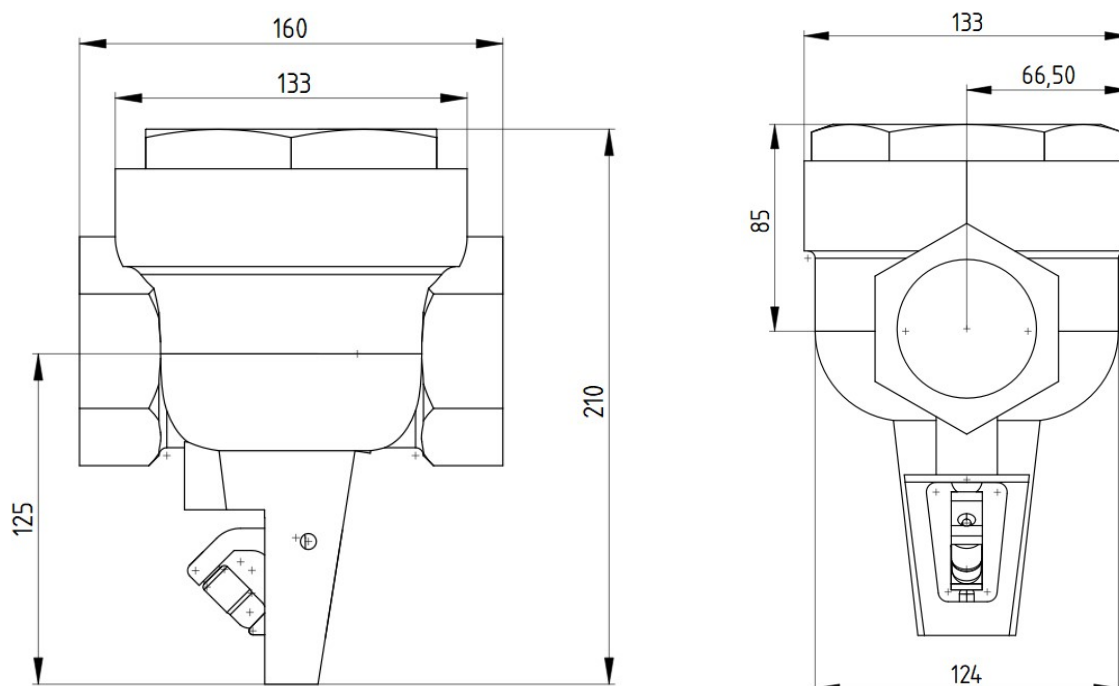

### Flow & Threaded Connections

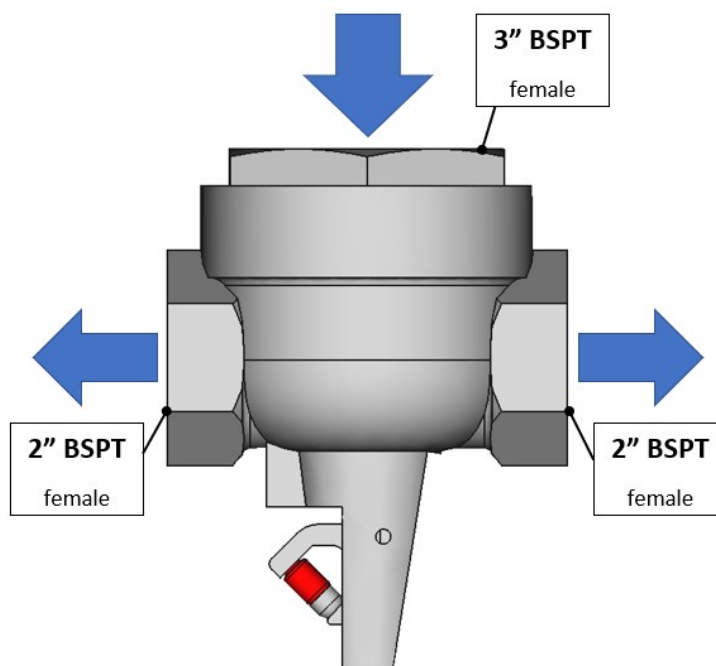

**GW SPRINKLER A/S**  
Kastanievej 15, DK 5620-Glamsbjerg, Denmark  
TEL: +45 64722055 FAX: +45 64722255  
Email: [sales.dep@gwspinkler.com](mailto:sales.dep@gwspinkler.com)  
Data sheet also available at [www.gwsprinkler.com](http://www.gwsprinkler.com)

Data Sheet: GW Multiple Jet Control  
80mm, heat activated  
(12mm bulb)

Page: 2 of 4

Issue / Date: 01<sup>st</sup> November 2022

**DATA SHEET No: GW MJ050 1002 A**

# GW

## MULTIPLE JET CONTROL (MJC)

80mm (3") / heat activated (12mm bulb)



GW SPRINKLER A/S

### Pressure loss through 80mm MJC valve

| Flow rate (lpm) | Flow Rate (GPM) | Pressure Loss (bar) | Pressure Loss (PSI) |
|-----------------|-----------------|---------------------|---------------------|
| 500             | 132,3           | 0,33                | 4,8                 |
| 600             | 158,7           | 0,49                | 7,1                 |
| 700             | 185,2           | 0,66                | 9,6                 |
| 800             | 211,6           | 0,87                | 12,6                |
| 900             | 238,1           | 1,10                | 16,0                |
| 1000            | 264,6           | 1,35                | 19,6                |
| 1100            | 291,0           | 1,60                | 23,2                |
| 1200            | 317,5           | 1,95                | 28,3                |
| 1300            | 343,9           | 2,30                | 33,3                |

### Installation – heat actuated MJCs

The MJC is designed to be installed in accordance with recognized installation standards. Deviation from the standards or any alteration to the MJC after it has left the factory including, but not limited to: painting, plating, coating or modification/repair, may render the valve inoperative and will automatically nullify any approval, or guarantee made by GW Sprinkler A/S.

Always install MJCs in the pendent position, which is with the heat sensitive glass bulb at the bottom and the water inlet on top. Discharge pipework must be supported at a maximum of 600mm from each MJC outlet.

Do not unpack MJCs until required for fitting to pipework to avoid damage to threads or the release mechanism. Preferably install MJCs to pipework that is already in place and not lying on the ground or on a bench, to avoid mechanical damage. Use contract or site approved pipe sealant.

- Always tighten using the spanner flats provided on valve body.
- **Never tighten MJCs on to the water inlet by inserting a spanner handle or pipe into the outlets.** This may damage the seal mechanism inside or unscrew the body of the MJC from the inlet spigot. **Always handle the MJC-valve with utmost care** and avoid any physical impact on the product!
- Never install an MJC valve that has been dropped or damaged.
- Never install any MJC if the glass bulb is cracked and/or there is loss of liquid from the bulb.

### Pressure Testing

MJC valves are water and air tight on the **inlet side** (upstream). They are not intended to be air or water tight on the outlet side (downstream), which is normally dry, and connected to a range of open spray nozzles.

When pressure testing downstream pipework (normally unpressurized in service), water may be seen to drip from above the bulb / lever assembly, this is not detrimental to the operation of the MJC.

GW SPRINKLER A/S  
Kastanievej 15, DK 5620-Glamsbjerg, Denmark  
TEL: +45 64722055 FAX: +45 64722255  
Email: [sales.dep@gwspinkler.com](mailto:sales.dep@gwspinkler.com)  
Data sheet also available at [www.gwsprinkler.com](http://www.gwsprinkler.com)

Data Sheet: GW Multiple Jet Control  
80mm, heat activated  
(12mm bulb)

Page: 3 of 4

Issue / Date: 01<sup>st</sup> November 2022

DATA SHEET No: **GW MJ050 1002 A**

# GW

## MULTIPLE JET CONTROL (MJC)

80mm (3") / heat activated (12mm bulb)



GW SPRINKLER A/S

### Care and Maintenance

GW MJC valves should be inspected monthly for damage, paint, corrosion, signs of leakage, deposits or build-up of dirt/salts.

Where corrosion or dirt is an issue it may be advisable to remove a proportion of the installed MJCs and return them to GW for inspection.

Where MJCs become coated in dust, this can be carefully removed with a light brush.

***Do not use compressed air – and avoid contact with the glass bulb!***

Conduct inspections using qualified persons. This may include the installing contractor or a contractor licensed, certified, or approved by local authorities.

### After a fire, accidental actuation or damage

GW MJC valves are factory built one-shot units, and cannot be reset or rebuilt on site.

Replacement units should always be held on site so that damaged or actuated units can be replaced quickly.

---

**GW SPRINKLER A/S**  
Kastanievej 15, DK 5620-Glamsbjerg, Denmark  
TEL: +45 64722055 FAX: +45 64722255  
Email: [sales.dep@gwspinkler.com](mailto:sales.dep@gwspinkler.com)  
Data sheet also available at [www.gwsprinkler.com](http://www.gwsprinkler.com)

**DATA SHEET No: GW MJ050 1002 A**

Data Sheet: GW Multiple Jet Control  
80mm, heat activated  
(12mm bulb)

Page: 4 of 4

Issue / Date: 01<sup>st</sup> November 2022